


# Electrical Heating in a Busbar Assembly

## Introduction

---

This tutorial analyzes the anode to busbar coupling designed to conduct a direct current from a current source to the anode in an electrolysis process, such as the chlor-alkali process for the production of chlorine and sodium. The current that passes from the intercell busbar to the anode produces heat due to the resistive losses, a phenomenon referred to as Joule heating. The Joule heating effect is described by conservation laws for electric current and energy. Once solved for, the two conservation laws give the temperature and electric field, respectively.

The geometry for the simulation, displayed in [Figure 1](#), includes the coupling components for one cell, and a section of the intercell busbar that is connected to the power source. It consists of the top of the anode with four central columns holding copper rods attached to copper bars.

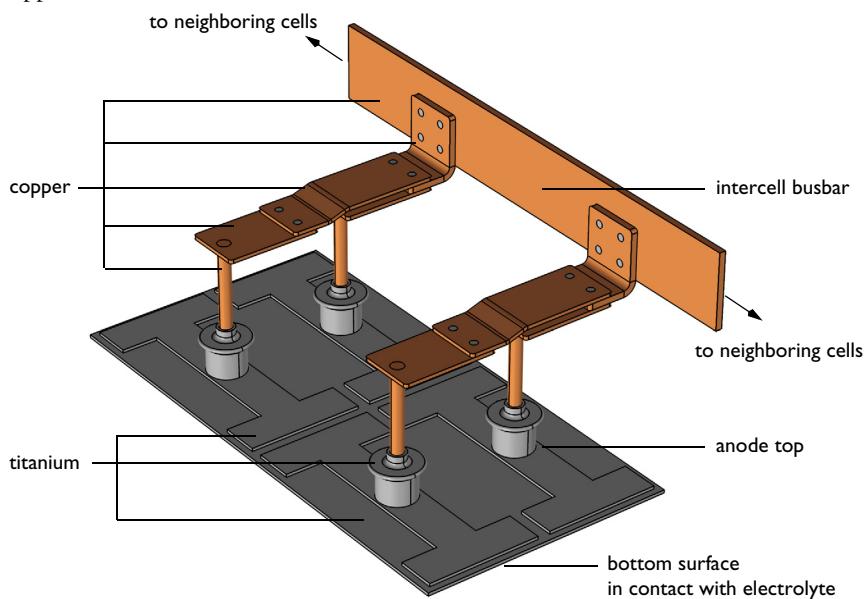

*Figure 1: The geometry of the anode to busbar coupling used in this example.*

When designing the coupling to the busbar it is important to aim for a low operational temperature for the copper components to avoid excessive oxidation and to maintain a high electrical conductivity. The goal of your simulation is to precisely calculate how much the busbar heats up, and to study the influence of two design parameters, the diameter of the rods rising from the top of the anode and the width of the copper connectors that link


to the intercell busbar, on the phenomenon. By conducting a parametric sweep you can determine which combinations of these parameters result in a maximum temperature in the copper components that is less than 90°C. Above this temperature the oxidation rate of copper starts to increase.

### *Model Definition*

---

The intercell busbar, the various connector bars, and the rods rising from the anode are made of copper. For the components of the anode and the bolts that hold the copper busbars together, we choose titanium assuming a highly corrosive environment.

All surfaces, except the anode bottom surface in contact with the electrolyte and the grounded surfaces of the intercell busbar, are cooled by natural convection in the air surrounding the busbar. We use the convective heat flux boundary condition for the purpose, assuming a cell room temperature of to 35°C. The same boundary condition is applied at the bottom surface of the anode, where the temperature of the surrounding electrolyte is set to 100°C. The intercell busbar cross section boundaries do not contribute to cooling or heating of the device. The electric potential at these boundaries is 0 V. At the bottom surface of the anode the normal current density is set to 8,000 A/m<sup>2</sup>.

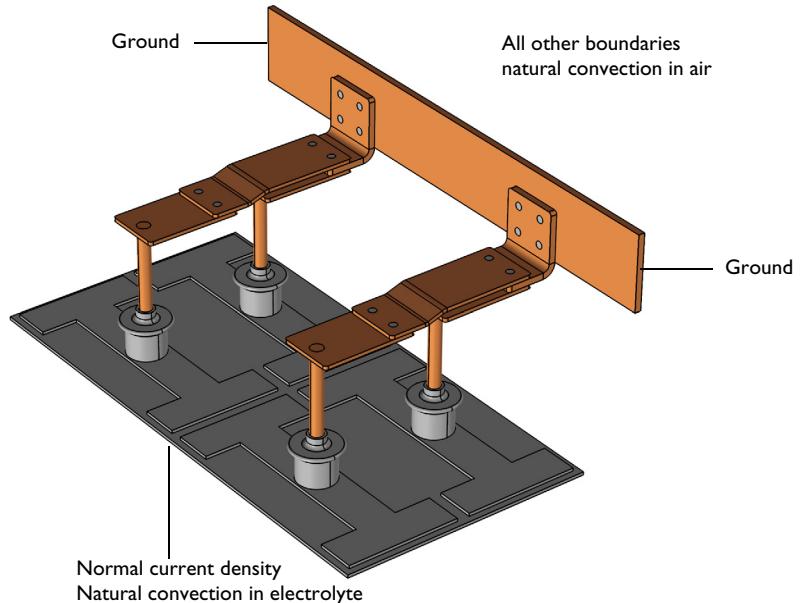


*Figure 2: Boundary settings in the model.*

## Results and Discussion

---

The plot shown in [Figure 3](#) displays the temperature in the device, which is substantially higher than the ambient temperature 35°C. The highest temperature is experienced by the titanium parts in contact with the hot electrolyte. For the copper components, the temperature variation is largest in the copper rods.

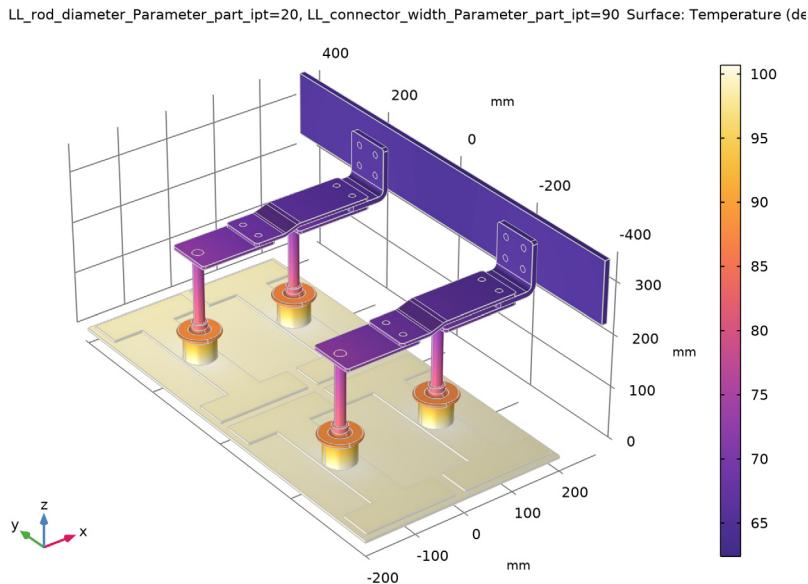

*Figure 3: Temperature distribution in the busbar.*

The temperature distribution is symmetric with a vertical mirror plane running through the anode at a right angle to the intercell busbar. In this case, the model does not require much computing power and you can model the whole geometry. For more complex models, you should consider using symmetries in order to reduce the size of the model.

Increasing the diameter of the copper rod and the width of the connector rods, while keeping the applied current density constant, leads to a lower temperature in the device. While the increased cross-sectional area leads to more heat produced by resistive losses, there is an even larger increase in the cooling effect as the total surface area increases, resulting in the lowering of the temperature.

By plotting the maximum temperature in the copper components against the diameter and width parameters, and formatting the plot according to [Figure 4](#), we can easily determine

the combinations of the diameter and width parameters that lead to an acceptable value of the maximum temperature.

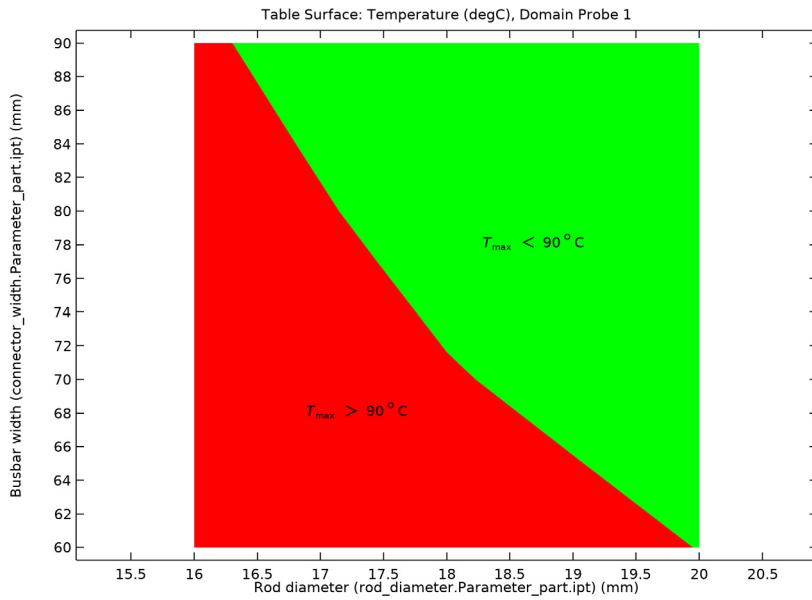


Figure 4: Maximum temperature in the busbar assembly plotted against the rod diameter and the connector width parameters, and formatted to show the parameter combinations that lead to a maximum temperature of less than  $90^{\circ}\text{C}$ .

#### Notes About the COMSOL Implementation

---

The busbar geometry you are using in this example comes from an Inventor assembly. The LiveLink interface transfers the geometry from Inventor to COMSOL Multiphysics. Using the interface you are also able to update the dimensions of the busbar in the Inventor file. In order for this to work you need to have both programs running during modeling, and you need to make sure that the busbar assembly file is the active file in Inventor.

---

**Application Library path:** `LiveLink_for_Inventor/Tutorials,  
_LiveLink_Interface/busbar_llinventor`

---

## *Modeling Instructions*

---

You can set up this simulation both by working inside Inventor, using the embedded COMSOL simulation environment, and by working in the standalone COMSOL Desktop. Regardless which way you proceed, first you need to open the CAD file with the geometry in Inventor.

- 1 In Inventor open the file `busbar_assembly_cad/busbar_assembly.iam` located in the model's Application Library folder.
- 2 Switch to the COMSOL Desktop, and skip the next section. Or, continue below if you are working inside Inventor.

### **MODELING INSIDE INVENTOR**

- 1 On the **COMSOL Multiphysics** tab click the **New** button.

In case it is not already running, the COMSOL modeling environment will be started, and the geometry will be synchronized automatically.

- 2 Continue with step 2 under the Model Wizard section.

### **COMSOL DESKTOP**

From the **File** menu, choose **New**.

### **NEW**

In the **New** window, click  **Model Wizard**.

### **MODEL WIZARD**

- 1 In the **Model Wizard** window, click  **3D**.
- 2 In the **Select Physics** tree, select **Heat Transfer>Electromagnetic Heating>Joule Heating**.
- 3 Click **Add**.
- 4 Click  **Study**.
- 5 In the **Select Study** tree, select **General Studies>Stationary**.
- 6 Click  **Done**.

### **GEOMETRY 1**

The geometry is already synchronized if you are modeling inside Inventor, and you can skip to step 4 in the section LiveLink for Inventor 1 (cad1).

Make sure that the CAD Import Module kernel is used.

- 1 In the **Model Builder** window, under **Component 1 (comp1)** click **Geometry 1**.

2 In the **Settings** window for **Geometry**, locate the **Advanced** section.

3 From the **Geometry representation** list, choose **CAD kernel**.


*LiveLink for Inventor 1 (cad1)*

1 Right-click **Component 1 (comp1)**>**Geometry 1** and choose **LiveLink Interfaces**>  
**LiveLink for Inventor**.

2 In the **Settings** window for **LiveLink for Inventor**, locate the **Synchronize** section.

3 Click **Synchronize**.

After a few moments the geometry of the busbar assembly appears in the **Graphics** window.

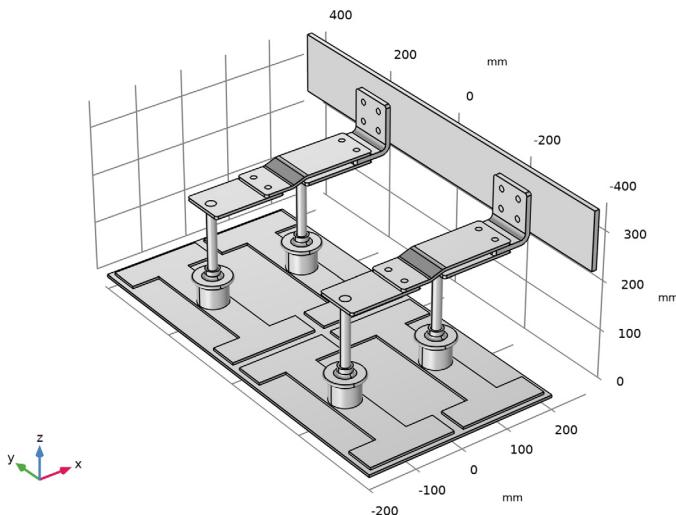

4 Click to expand the **Parameters in CAD Package** section. The table contains the two dimensions, **rod\_diameter.Parameter\_part. ipt** and **connector\_width.Parameter\_part. ipt**, which are part of the Inventor model. In Inventor, the **Parameter Selection** button on the **COMSOL Multiphysics** tab allows you to select and view dimensions for synchronization. These dimensions are retrieved, and appear in the **CAD name** column of the table. The corresponding entries in the **COMSOL name** column, **LL\_rod\_diameter\_Parameter\_part\_ipt** and **LL\_connector\_width\_Parameter\_part\_ipt**, are global parameters in the COMSOL model. These are automatically generated during synchronization, and are assigned the

values of the linked Inventor dimensions. The parameter values are displayed in the **COMSOL value** column.

Global parameters in a model allow you to parameterize settings and can be controlled by the parametric solver to perform parametric sweeps. Thus, by linking Inventor dimensions to COMSOL global parameters, the parametric solver can automatically update and synchronize the geometry for each new value in a sweep.

- 5 Click to expand the **Object Selections** section. The selections displayed here are automatically generated based on the assigned materials in the Inventor components.
- 6 Click to expand the **Boundary Selections** section. The selections listed here are user defined selections saved in the Inventor files for the components that they appear on. In Inventor, you can set-up selections using the **Selections** button on the **COMSOL Multiphysics** tab.

Skip the next step if you are working in the embedded COMSOL simulation environment inside Inventor.

- 7 Right-click **LiveLink for Inventor 1 (cad1)** and choose **Build All**.

*Adjacent Selection 1 (adjsel1)*

- 1 In the **Model Builder** window, right-click **Geometry 1** and choose **Selections>Adjacent Selection**.
- 2 In the **Settings** window for **Adjacent Selection**, locate the **Input Entities** section.
- 3 Click  **Add**.
- 4 In the **Add** dialog box, in the **Input selections** list, choose **Copper** and **Titanium**.
- 5 Click **OK**.
- 6 In the **Settings** window for **Adjacent Selection**, locate the **Resulting Selection** section.
- 7 From the **Show in physics** list, choose **Off**.

*Heat flux boundaries*

- 1 Right-click **Geometry 1** and choose **Selections>Difference Selection**.
- 2 In the **Settings** window for **Difference Selection**, type **Heat flux boundaries** in the **Label** text field.
- 3 Locate the **Geometric Entity Level** section. From the **Level** list, choose **Boundary**.
- 4 Locate the **Input Entities** section. Click  **Add**.
- 5 In the **Add** dialog box, select **Adjacent Selection 1** in the **Selections to add** list.
- 6 Click **OK**.
- 7 In the **Settings** window for **Difference Selection**, locate the **Input Entities** section.

- 8 Click  **Add**.
- 9 In the **Add** dialog box, in the **Selections to subtract** list, choose **Electrolyte boundary** and **Grounded boundaries**.
- 10 Click **OK**.

## GLOBAL DEFINITIONS

### Parameters 1

The table already contains the automatically generated global parameters that are linked to the Inventor dimensions. It is possible to edit the values of these parameters here, and then synchronize, to modify the geometry. But here we will use the parametric solver to modify the parameters.

Continue with loading additional parameters for setting up the physics.

- 1 In the **Model Builder** window, under **Global Definitions** click **Parameters 1**.
- 2 In the **Settings** window for **Parameters**, locate the **Parameters** section.
- 3 Click  **Load from File**.
- 4 Browse to the model's Application Libraries folder and double-click the file `busbar_parameters.txt`.

## MATERIALS

### Add Material

From the **Home** menu, choose **Add Material**.

#### ADD MATERIAL

- 1 Go to the **Add Material** window.
- 2 In the tree, select **Built-in>Copper**.
- 3 Click **Add to Component** in the window toolbar.

## MATERIALS

### Copper (mat1)

- 1 In the **Settings** window for **Material**, locate the **Geometric Entity Selection** section.
- 2 From the **Selection** list, choose **Copper**.

#### ADD MATERIAL

- 1 Go to the **Add Material** window.

- 2 In the tree, select **Built-in>Titanium beta-21S**.
- 3 Click **Add to Component** in the window toolbar.

#### *Add Material*

- 1 From the **Home** menu, choose **Add Material**.
- 2 In the **Settings** window for **Material**, locate the **Geometric Entity Selection** section.
- 3 From the **Selection** list, choose **Titanium**.

## **ELECTRIC CURRENTS (EC)**

#### *Ground 1*

- 1 In the **Model Builder** window, under **Component 1 (comp1)** right-click **Electric Currents (ec)** and choose **Ground**.
- 2 In the **Settings** window for **Ground**, locate the **Boundary Selection** section.
- 3 From the **Selection** list, choose **Grounded boundaries**.

#### *Normal Current Density 1*

- 1 In the **Model Builder** window, right-click **Electric Currents (ec)** and choose **Normal Current Density**.
- 2 In the **Settings** window for **Normal Current Density**, locate the **Boundary Selection** section.
- 3 From the **Selection** list, choose **Electrolyte boundary**.
- 4 Locate the **Normal Current Density** section. In the  $J_n$  text field, type Jan.

## **HEAT TRANSFER IN SOLIDS (HT)**

#### *Heat Flux 1*

- 1 In the **Model Builder** window, under **Component 1 (comp1)** right-click **Heat Transfer in Solids (ht)** and choose **Heat Flux**.
- 2 In the **Settings** window for **Heat Flux**, locate the **Boundary Selection** section.
- 3 From the **Selection** list, choose **Heat flux boundaries**.
- 4 Locate the **Heat Flux** section. From the **Flux type** list, choose **Convective heat flux**.
- 5 In the  $h$  text field, type htca.
- 6 In the  $T_{ext}$  text field, type Ta.

#### *Heat Flux 2*

- 1 In the **Model Builder** window, right-click **Heat Transfer in Solids (ht)** and choose **Heat Flux**.
- 2 In the **Settings** window for **Heat Flux**, locate the **Boundary Selection** section.

- 3 From the **Selection** list, choose **Electrolyte boundary**.
- 4 Locate the **Heat Flux** section. From the **Flux type** list, choose **Convective heat flux**.
- 5 In the  $h$  text field, type `htce`.
- 6 In the  $T_{\text{ext}}$  text field, type `Te`.

#### **MESH 1**

- 1 In the **Model Builder** window, under **Component 1 (comp1)** click **Mesh 1**.
- 2 In the **Settings** window for **Mesh**, locate the **Sequence Type** section.
- 3 From the list, choose **User-controlled mesh**.

#### **Size**

- 1 In the **Model Builder** window, under **Component 1 (comp1)>Mesh 1** click **Size**.
- 2 In the **Settings** window for **Size**, locate the **Element Size** section.
- 3 Click the **Custom** button.
- 4 Locate the **Element Size Parameters** section. In the **Minimum element size** text field, type `mh`.
- 5 Click  **Build All**.

#### **STUDY 1**

##### *Parametric Sweep*

- 1 In the **Model Builder** window, right-click **Study 1** and choose **Parametric Sweep**.
- 2 In the **Settings** window for **Parametric Sweep**, locate the **Study Settings** section.
- 3 Click  **Add**.
- 4 From the list in the **Parameter name** column, choose `LL_rod_diameter_Parameter_part_ipt`.
- 5 Click  **Range**.
- 6 In the **Range** dialog box, type `16[mm]` in the **Start** text field.
- 7 In the **Step** text field, type `2[mm]`.
- 8 In the **Stop** text field, type `20[mm]`.
- 9 Click **Replace**.
- 10 In the **Parameter unit** column, enter `mm`.
- 11 In the **Settings** window for **Parametric Sweep**, locate the **Study Settings** section.
- 12 Click  **Add**.
- 13 Click to select row number 2 in the table.

**I4** From the list in the **Parameter name** column, choose **LL\_connector\_width\_Parameter\_part\_ipt**.

**I5** Click  **Range**.

**I6** In the **Range** dialog box, type **60[mm]** in the **Start** text field.

**I7** In the **Step** text field, type **10[mm]**.

**I8** In the **Stop** text field, type **90[mm]**.

**I9** Click **Replace**.

**I10** In the **Parameter unit** column, enter **mm**.

As the last step before computing the solution, configure the sweep to include all combinations of the two parameters.

**I11** In the **Settings** window for **Parametric Sweep**, locate the **Study Settings** section.

**I12** From the **Sweep type** list, choose **All combinations**.

#### *Solution 1 (sol1)*

**I** Right-click **Study 1** and choose **Show Default Solver**.

**2** In the **Model Builder** window, expand the **Solution 1 (sol1)** node.

**3** In the **Model Builder** window, expand the **Study 1>Solver Configurations>Solution 1 (sol1)>Stationary Solver 1** node, then click **Segregated 1**.

**4** In the **Settings** window for **Segregated**, locate the **General** section.

**5** From the **Stabilization and acceleration** list, choose **Anderson acceleration**.

**6** Right-click **Study 1>Solver Configurations>Solution 1 (sol1)>Stationary Solver 1>Segregated 1** and choose **Compute**.

## **RESULTS**

### *Temperature (ht)*

**I** In the **Settings** window for **3D Plot Group**, locate the **Plot Settings** section.

**2** From the **Color** list, choose **Gray**.

### *Surface*

**I** In the **Model Builder** window, expand the **Temperature (ht)** node, then click **Surface**.

**2** In the **Settings** window for **Surface**, locate the **Expression** section.

**3** From the **Unit** list, choose **degC**.

**4** Locate the **Coloring and Style** section. From the **Color table** list, choose **HeatCameraLight**.

5 Click  **Plot**.

You should now see a plot similar to the one in [Figure 3](#).

## DEFINITIONS

Add a domain probe to calculate the average temperature increase from ambient temperature in the device.

### *Domain Probe 1 (dom1)*


- 1 In the **Model Builder** window, under **Component 1 (comp1)** right-click **Definitions** and choose **Probes>Domain Probe**.
- 2 In the **Settings** window for **Domain Probe**, locate the **Probe Type** section.
- 3 From the **Type** list, choose **Maximum**.
- 4 Locate the **Source Selection** section. From the **Selection** list, choose **Copper**.
- 5 Click **Replace Expression** in the upper-right corner of the **Expression** section. From the menu, choose **Component 1 (comp1)>Heat Transfer in Solids>Temperature>T - Temperature - K**.
- 6 Locate the **Expression** section. From the **Table and plot unit** list, choose **degC**.
- 7 Click  **Update Results**.

## TABLE

- 1 Go to the **Table** window.

2 Click **Table Surface** in the window toolbar.

A plot similar to the one displayed below appears.

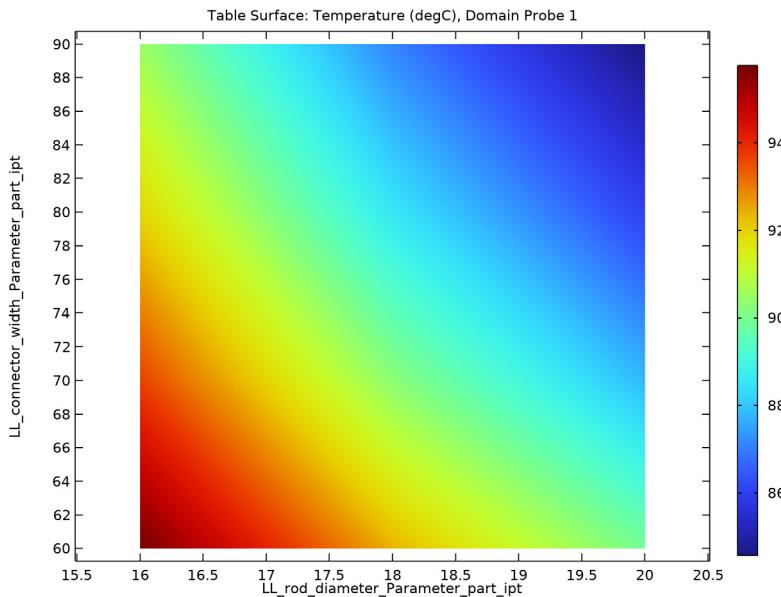

## RESULTS

In the last few steps you can add annotations and format the plot to make it easier to read which parameter combinations result in an accepted temperature increase.

### Table Surface 2

- 1 In the **Model Builder** window, under **Results>2D Plot Group 6** right-click **Table Surface 1** and choose **Duplicate**.
- 2 In the **Settings** window for **Table Surface**, click to expand the **Title** section.
- 3 From the **Title type** list, choose **None**.
- 4 Click to expand the **Range** section. Select the **Manual data range** check box.
- 5 In the **Maximum** text field, type 90.
- 6 Locate the **Coloring and Style** section. From the **Coloring** list, choose **Uniform**.
- 7 From the **Color** list, choose **Green**.

### Table Surface 1

- 1 In the **Model Builder** window, click **Table Surface 1**.

- 2 In the **Settings** window for **Table Surface**, locate the **Range** section.
- 3 Select the **Manual data range** check box.
- 4 In the **Minimum** text field, type 90.
- 5 Locate the **Coloring and Style** section. From the **Coloring** list, choose **Uniform**.

#### *2D Plot Group 6*

- 1 In the **Model Builder** window, click **2D Plot Group 6**.
- 2 In the **Settings** window for **2D Plot Group**, locate the **Plot Settings** section.
- 3 Select the **x-axis label** check box.
- 4 In the associated text field, type `Rod diameter`  
(`rod_diameter.Parameter_part.ipt`) (mm).
- 5 Select the **y-axis label** check box.
- 6 In the associated text field, type `Busbar width`  
(`connector_width.Parameter_part.ipt`) (mm).

#### *Annotation 1*

- 1 Right-click **2D Plot Group 6** and choose **Annotation**.
- 2 In the **Settings** window for **Annotation**, locate the **Data** section.
- 3 From the **Dataset** list, choose **Domain Probe 1**.
- 4 Locate the **Annotation** section. In the **Text** text field, type `$T_{\max} > 90 \degree \mathbf{C}`.
- 5 Locate the **Position** section. In the **x** text field, type `16.8[mm]`.
- 6 In the **y** text field, type `69[mm]`.
- 7 Locate the **Annotation** section. Select the **LaTeX markup** check box.
- 8 Locate the **Coloring and Style** section. Clear the **Show point** check box.

#### *Annotation 2*

- 1 Right-click **2D Plot Group 6** and choose **Annotation**.
- 2 In the **Settings** window for **Annotation**, locate the **Data** section.
- 3 From the **Dataset** list, choose **Domain Probe 1**.
- 4 Locate the **Annotation** section. In the **Text** text field, type `$T_{\max} < 90 \degree \mathbf{C}`.
- 5 Locate the **Position** section. In the **x** text field, type `18.2[mm]`.
- 6 In the **y** text field, type `79[mm]`.
- 7 Locate the **Annotation** section. Select the **LaTeX markup** check box.

8 Locate the **Coloring and Style** section. Clear the **Show point** check box.

9 Click  **Plot**.

The plot in the **Graphics** window should now look similar to the one in Figure 4.